TAG ID	DESCRIPTION
1001A, B	COMPRESSOR
1101A, B	MOTOR
1302A, B	DRYER BYPASS VALVE
1309A, B	WET AIR RECEIVER RELIEF VALVE
1311	EXTERNAL RECEIVER RELIEF VALVE (NOT SHOWN)
1317	DISCHARGE ISOLATION VALVE
1326A, B	DRYER INLET ISO VALVE
1327A, B	PRESSURE GAUGE ISO VALVE
1329A, B	DRYER DISCHARGE ISOLATION VALVE
1330	AUTOMATIC CONDENSATE DRAIN COMP. (NO LABEL)
1331A, B	WET AIR RECEIVER INLET ISOLATION VALVE
1332A,B	WET AIR RECEIVER DISCHARGE CHECK VALVE
1333A, B	WET AIR RECEIVER CONDENSATE DRAIN ISOLATION VALVE
1334A, B	OSC INLET ISOLATION VALVES
1335A, B	OSC INLET BYPASS VALVES
1336	DISCHARGE BYPASS VALVE
1341A, B	COALESCING PRE-FILTER DRYER
1342A, B	DRYER HEATLESS REGENERATIVE
1344	OIL WATER SEPERATOR CONDENSATE DRAINS (OSC)
1345A, B	COMPRESSOR DISCHARGE LINE ISO VALVES
1401A, B	WET AIR RECEIVER
1403	AUTOMATIC CONDENSATE DRAIN WET AIR RECEIVER
1404	MANUAL COND DRAIN VALVE WET AIR RECEIVER
1405	BYPASS VALVE AUTOMATIC CONDENSATE DRAIN
1408	ISOLATION VALVE AUTO DRAIN
1409	ISOLATION VALVE AUTO DRAIN W/STRAINER
1411	DRY AIR RECEIVER EXTERNAL MOUNT (NOT SHOWN)
1414	DRY AIR RECEIVER MANUAL CONDENSATE DRAIN (NOT SHOWN)
1528A, B	PRESSURE GAUGE WET AIR RECEIVERS
1701	SKID
1702	ENCLOSURE
1703	DOOR
1704	LIGHTING
1705	INLET LOUVER
1706	EXHAUST LOUVER
1707	EXHAUST FAN
1708	HEATER
1709	HEAT TRACE / INSULATION

ALL CONDENSATE DRAIN TUBING IS 3/8"
316 SS TUBING PRESSURIZED


CONDENSATE DRAIN TUBING ARRANGEMENT
MAY VARY FROM DISPLAY ON GA DRAWING


WET AIR RECEIVERS TAG # 1401A & B
MFG: SPVG SIZE IS 660 GAL. RATED
200 PSI @ 400 F 42" OD x 125 1/4" TALL


SAFETY RELIEF VALVES TAG # 1310A & B
MFG: MIDWEST CONTROLS ARE 1/2" NPT
ASME SOFT SEAT SAFETY VALVE RATED
AT 200 PSI & 777 SCFM

SKID IS CONSTRUCTED USING 6"@31# WIDE
FLANGE BEAM W/ 3/8" THK TOP PLATE

BUILDING ENCLOSURE WILL NOW BE A FLAT PANEL
STYLE WALL SYSTEM. WALLS & ROOF WILL BE INSULATED
WALLS R-20 & ROOF R-26.

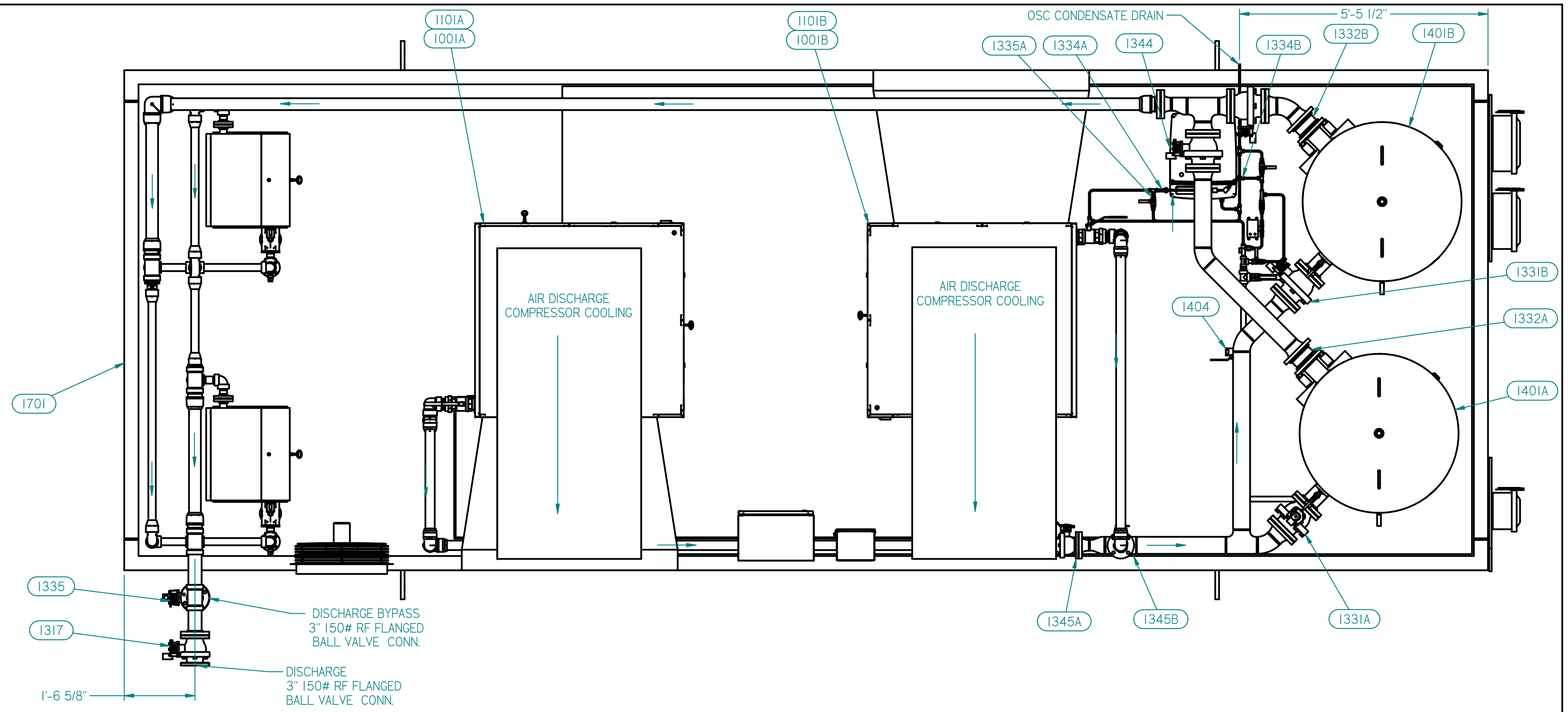

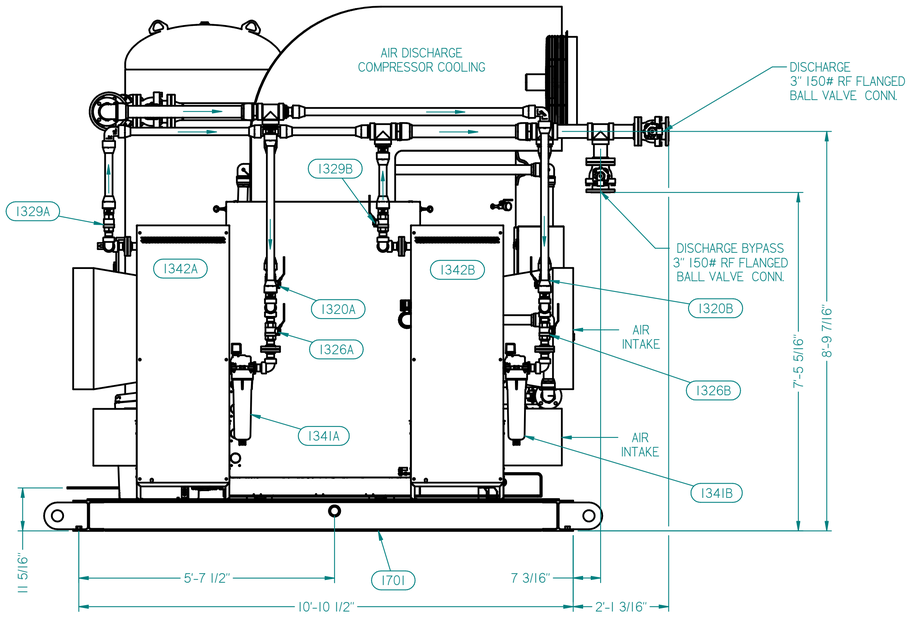

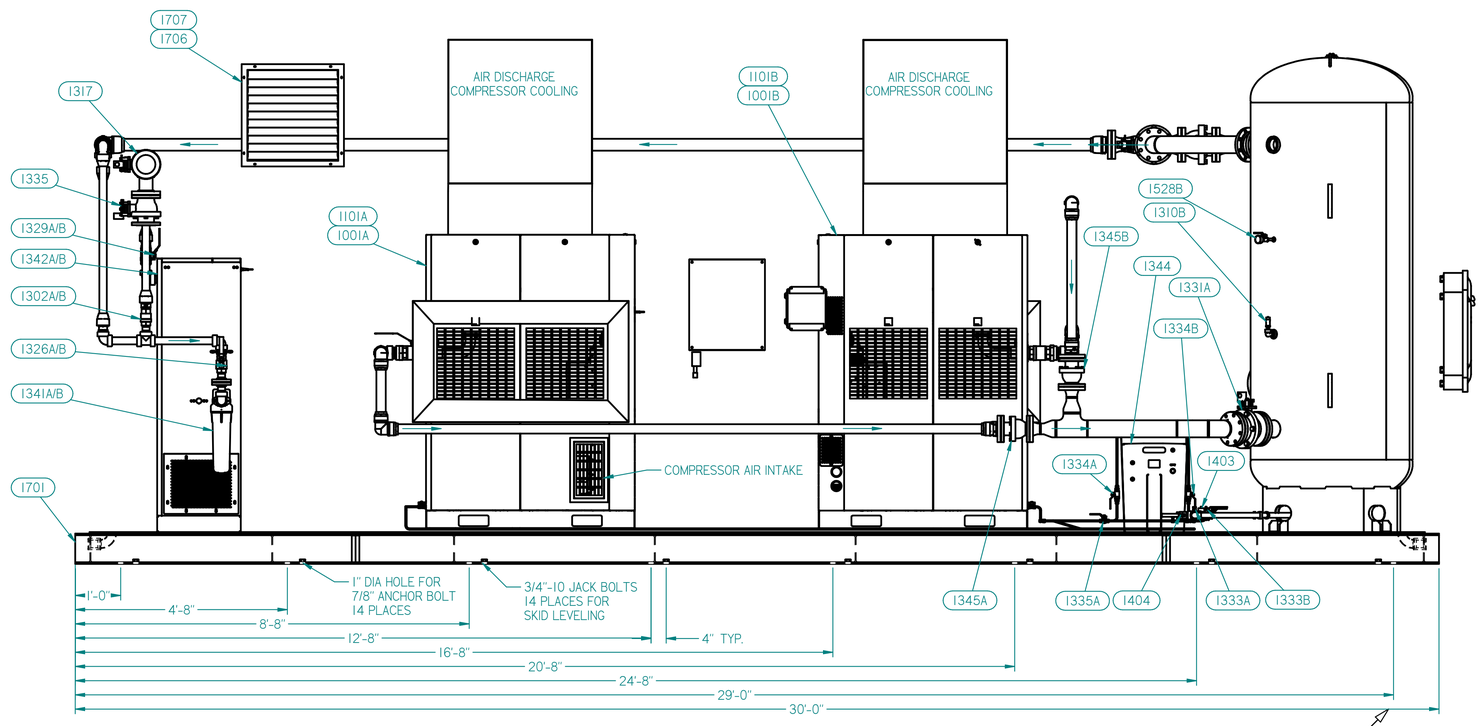


Tulsa, Ok.
Atlanta, Ga.
TESCORP
P.O. Box 471453
Tulsa,Oklahoma 74147


DATE:	SCALE:	DRAWN BY:	APPRD:	REVISION:
1/19/2026		DB		02

GENERAL ARRANGEMENT DRAWING
ATLAS COPCO GA110 DUPLEX INSTRUMENT AIR UNIT

CUSTOMER:	DRAWING NUMBER:
ISTI / ONEOK	F-01126-0001 GA

DATE	REVISION DISCRIPTION	BY

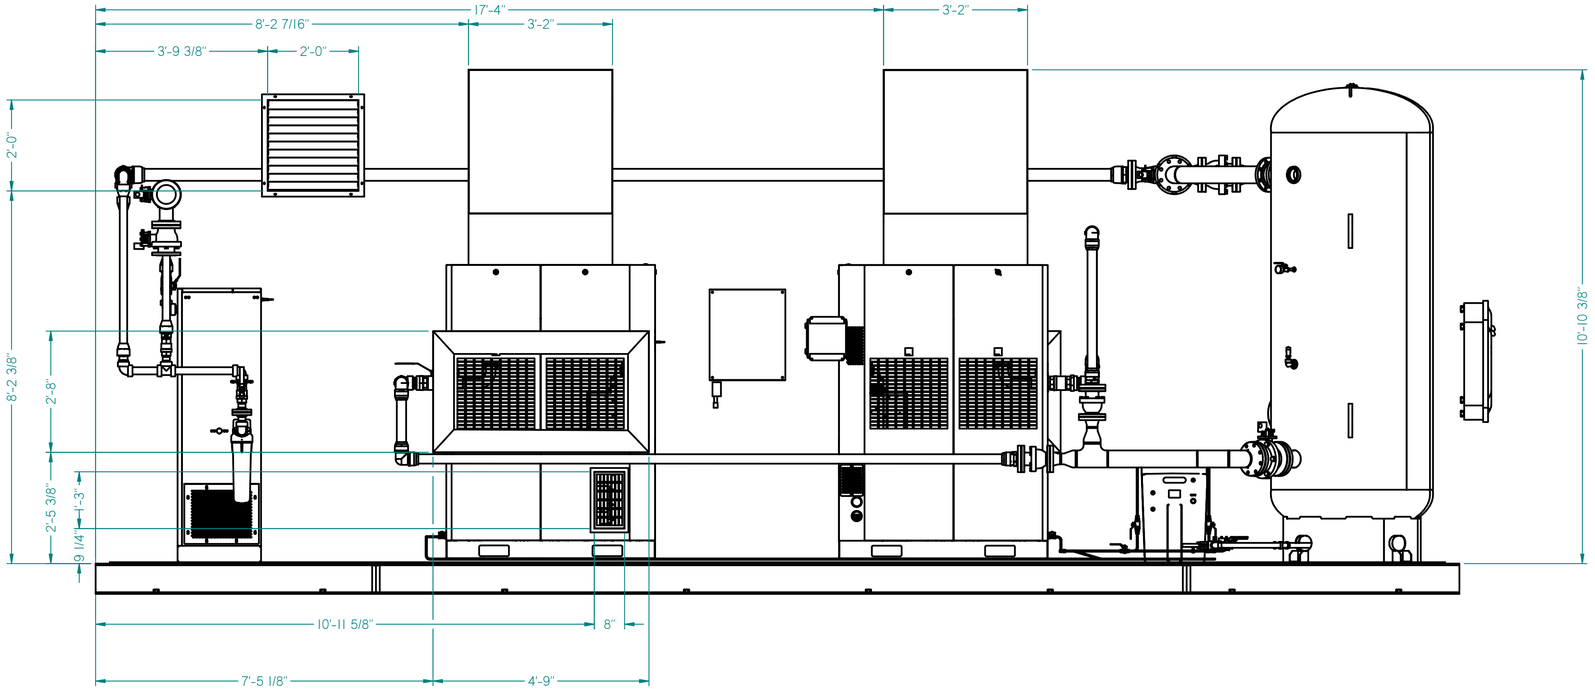

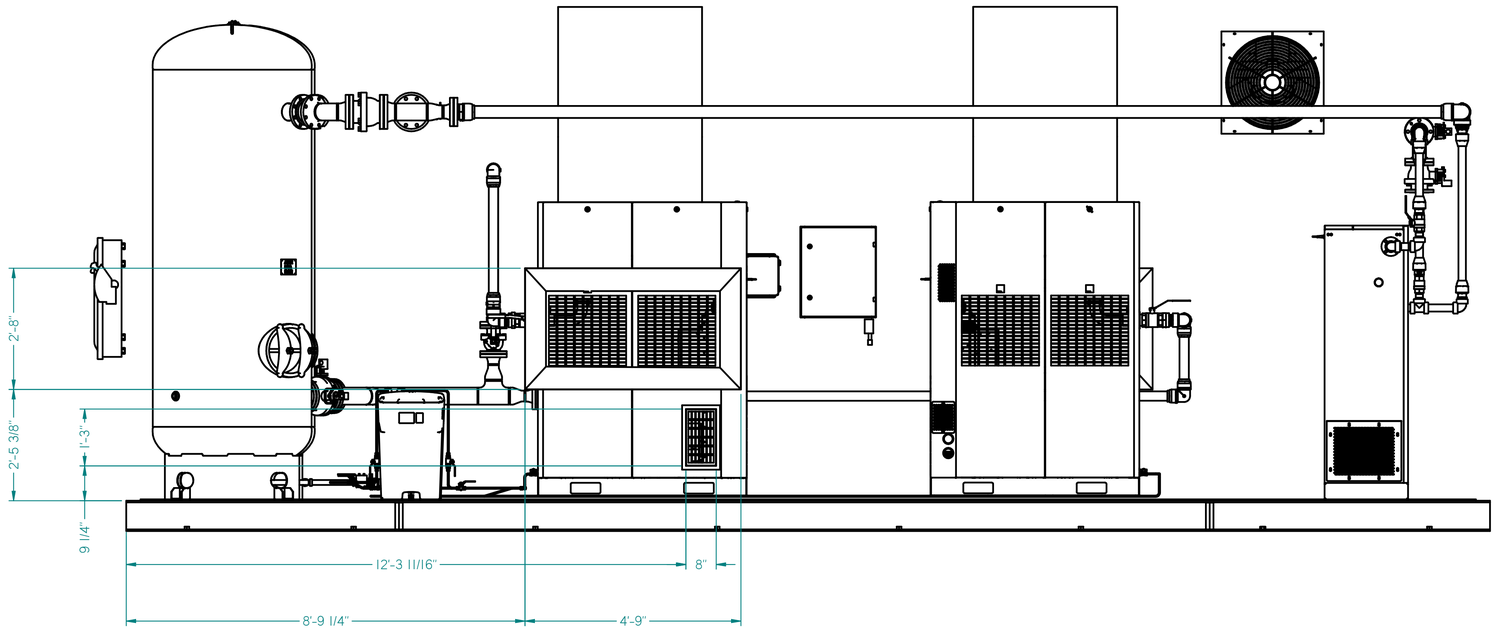

DATE	REVISION DISCRIPTION	BY

Tulsa, Ok.
Atlanta, Ga.

TESCORP

P.O. Box 471453
Tulsa,Oklahoma 74147

DATE:	SCALE:	DRAWN BY:	APPR'D:	REVISION

CUSTOMER:	DRAWING NUMBER: