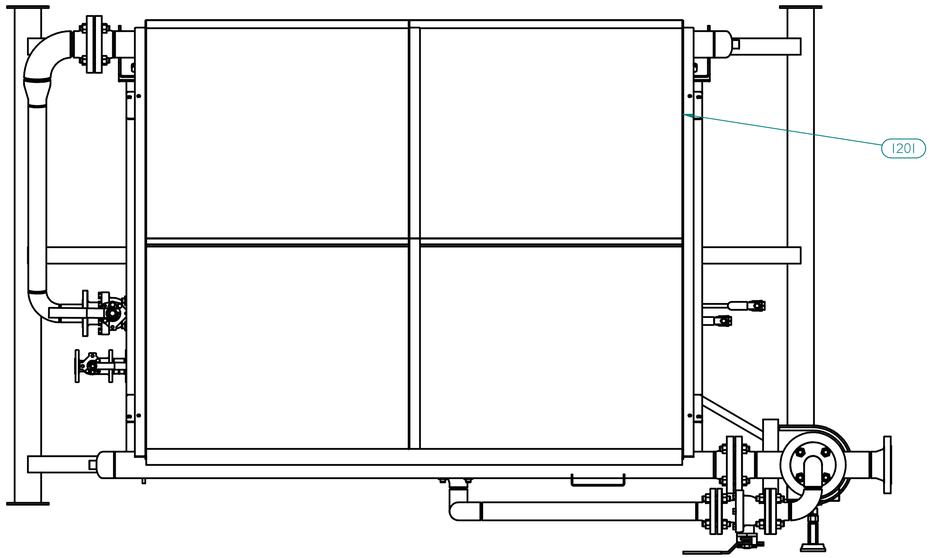

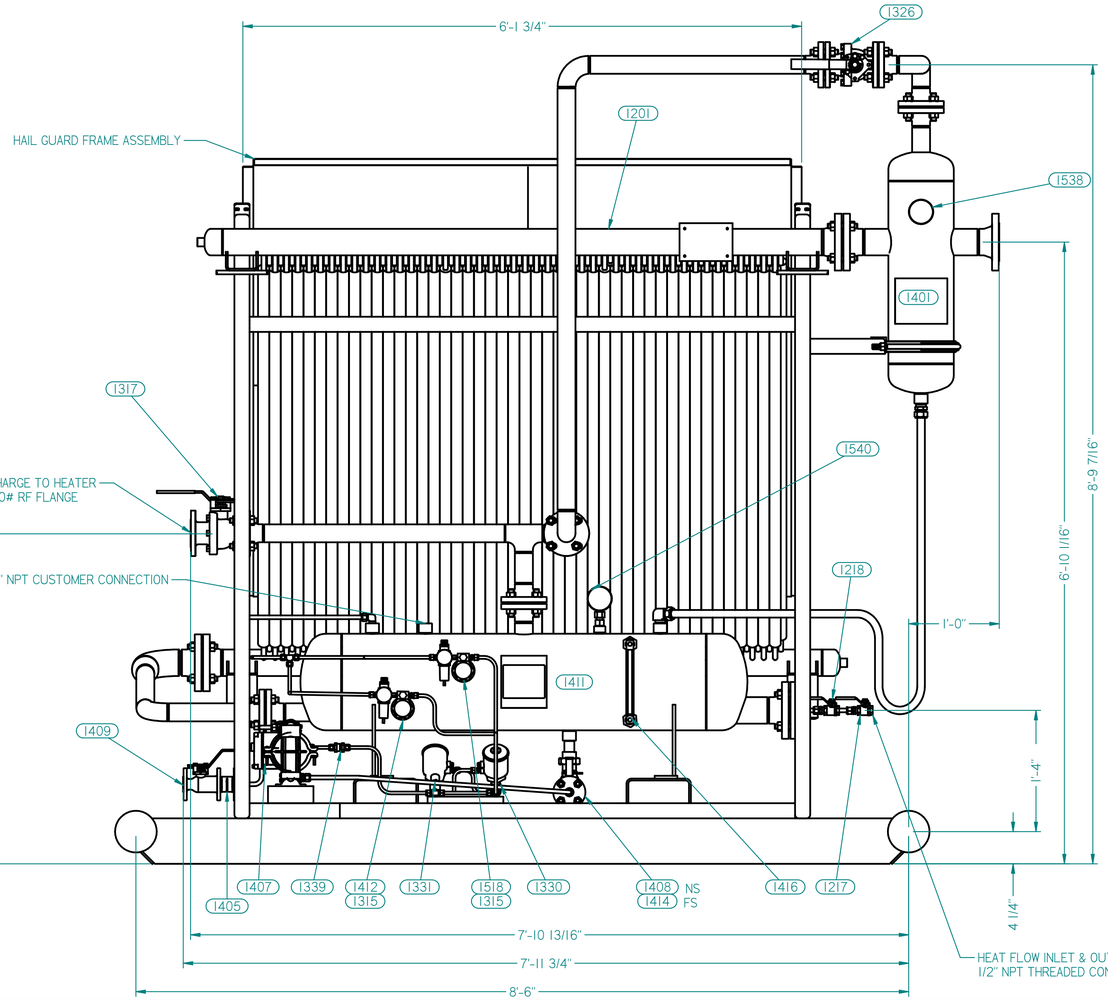

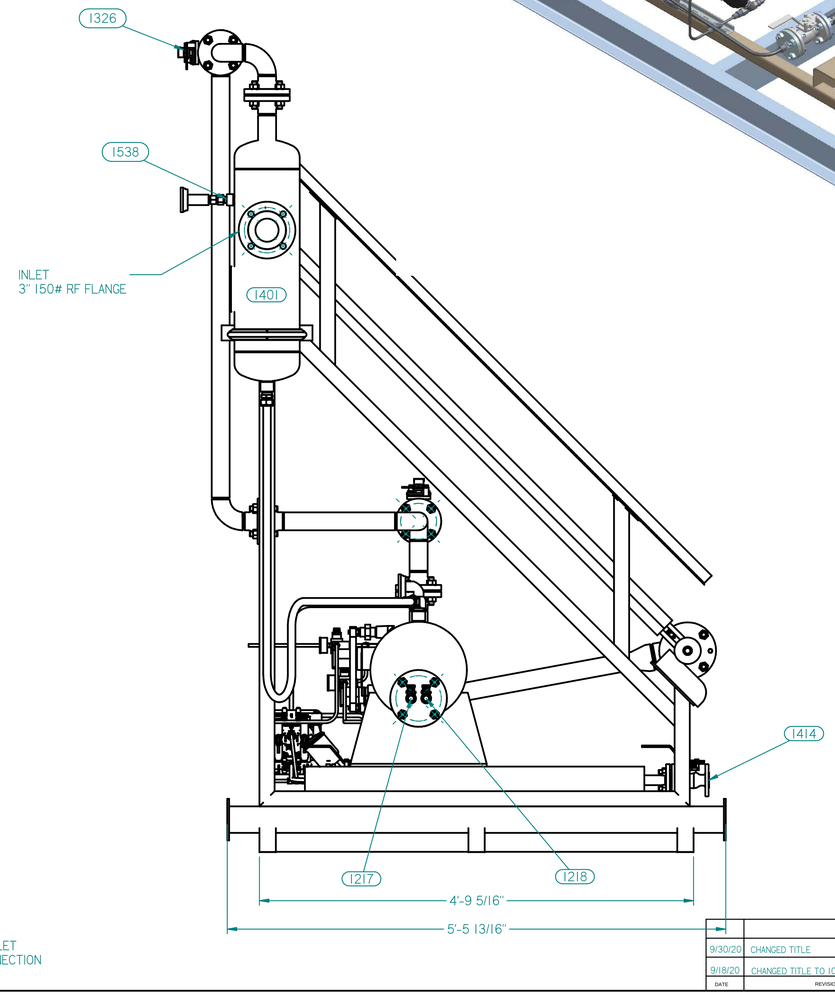

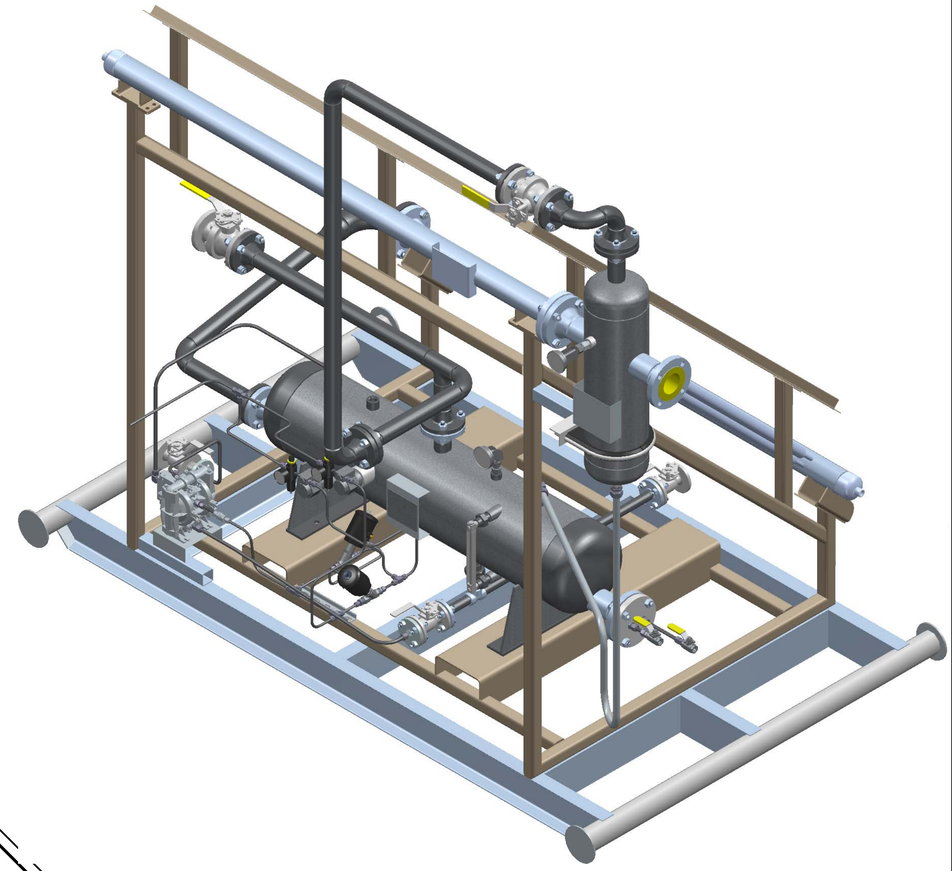

LEGEND	
1201	HEAT EXCHANGER ASSEMBLY
1217	ISOLATION VALVE
1218	ISOLATION VALVE
1315 A, B	INST. CONTROL REGULATOR W/ITEMS 1412 & 1518
1317	DISCHARGE ISOLATION VALVE
1326	BYPASS ISO VALVE
1330	PUMP CONTROL SOLENOID
1331	PUMP CONTROL SOLENOID
1339	CONDENSATE PUMP INLET CHECK VALVE
1401	INLET VESSEL
1405	CONDENSATE PUMP CHECK VALVE
1407	CONDENSATE PUMP
1408	CONDENSATE PUMP ISO VALVE
1409	CODENSATE PUMP DRAIN VALVE
1411	CONDENSATE VESSEL
1412	LIQUID LEVEL SWITCH LOW
1414	MANUAL DUMP VALVE
1415	CONDENSATE CHECK VALVE
1416	LIQUID LEVEL SITE GAUGE
1518	LIQUID LEVEL SWITCH HIGH
1538	TEMPERATURE GAUGE INLET VESSEL
1540	TEMPERATURE GAUGE

APPROXIMATE WEIGHT : 2,050 LBS

DATE	REVISION DISCRIPTION	BY
9/30/20	CHANGED TITLE	DB
9/18/20	CHANGED TITLE TO 108.2 MBTUH	DB

Tulsa, Ok.
Atlanta, Ga.

TESCORP

P.O. Box 471453
Tulsa,Oklahoma 74147

DATE:	SCALE:	DRAWN BY:	APPRD:	REVISION
2-9-2018		DB		02

BTEX CONDENSER UNIT
COND: 30 MMscfd / 148 MBTUH / 3 MPH Air Flow

CUSTOMER:	DRAWING NUMBER:
WGR OPERATING	F-0820-0351GA